




案内図

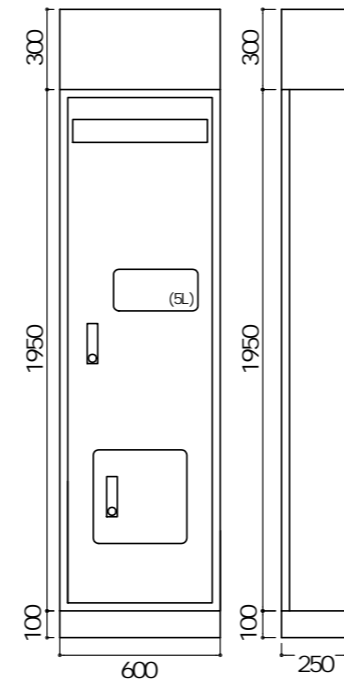

電灯分電盤 参考姿図

MCB3P100AF/100AT  
 MCB2P50AF/20AT(200V)× 6  
 MCB2P50AF/20AT(100V)× 10 ELB2P50AF/20AT(100V)× 13

(SL)× 1  
 ( W350 H:350 )

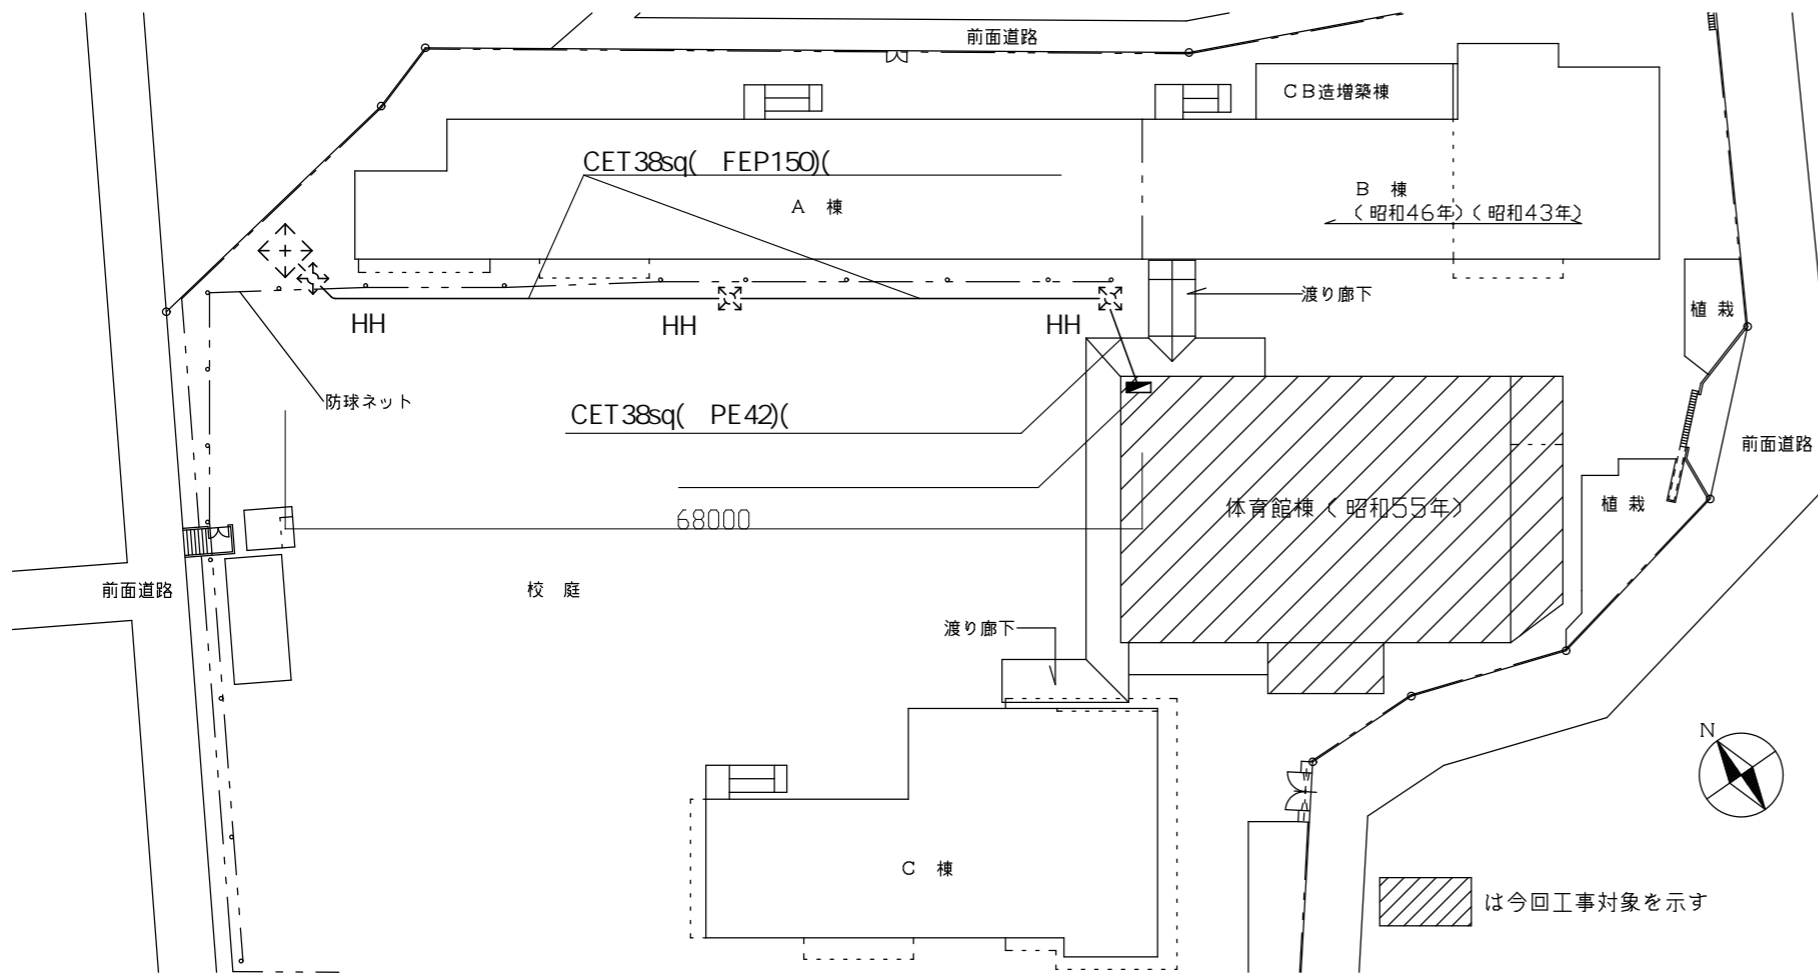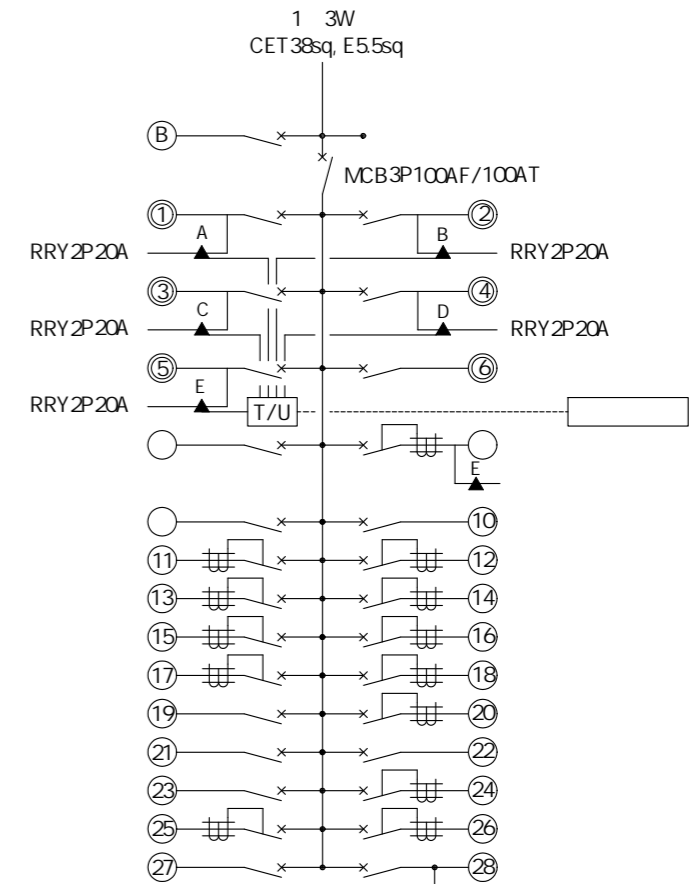

配置図 1/600


⊙ AC200V

⊙ AC100V


▲

は今回工事対象を示す


1階配線図 1:200

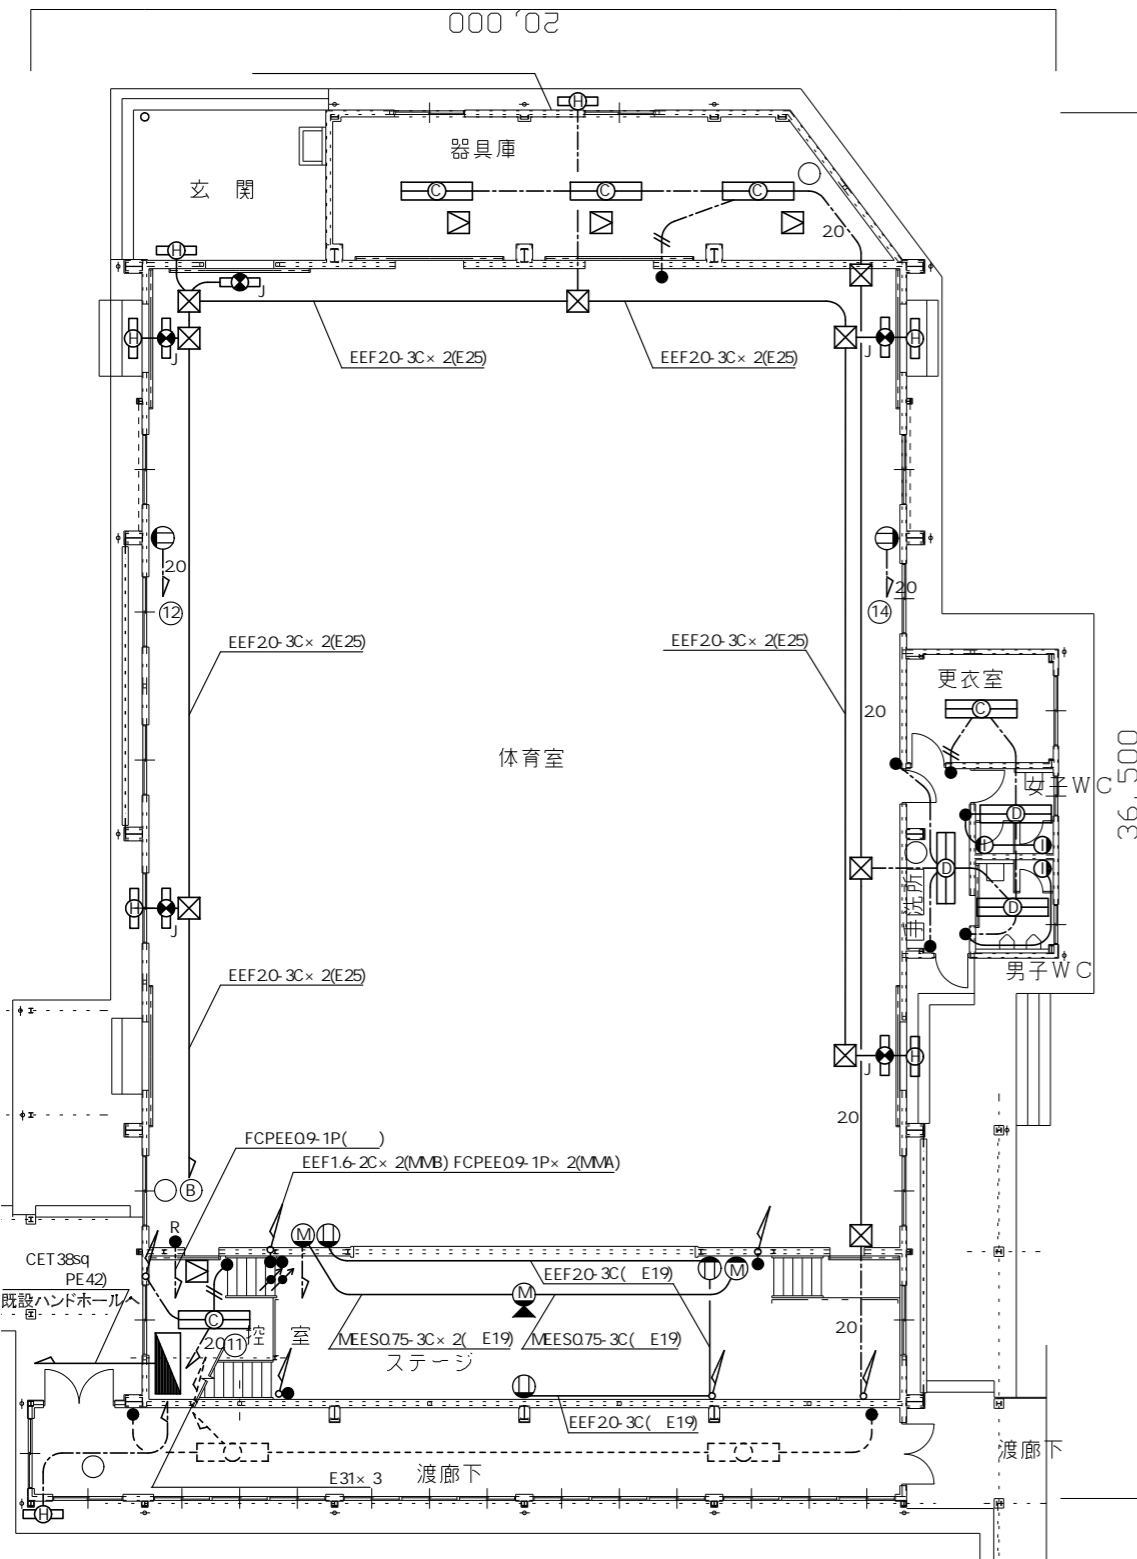

体育館1階改修平面図 1/200

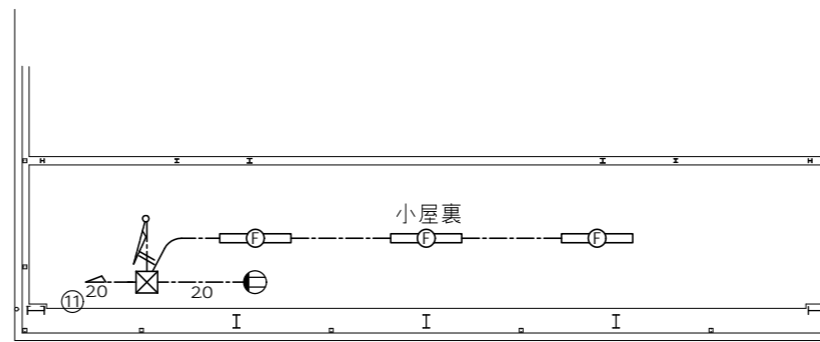


体育館小屋裏撤去平面図 1/200

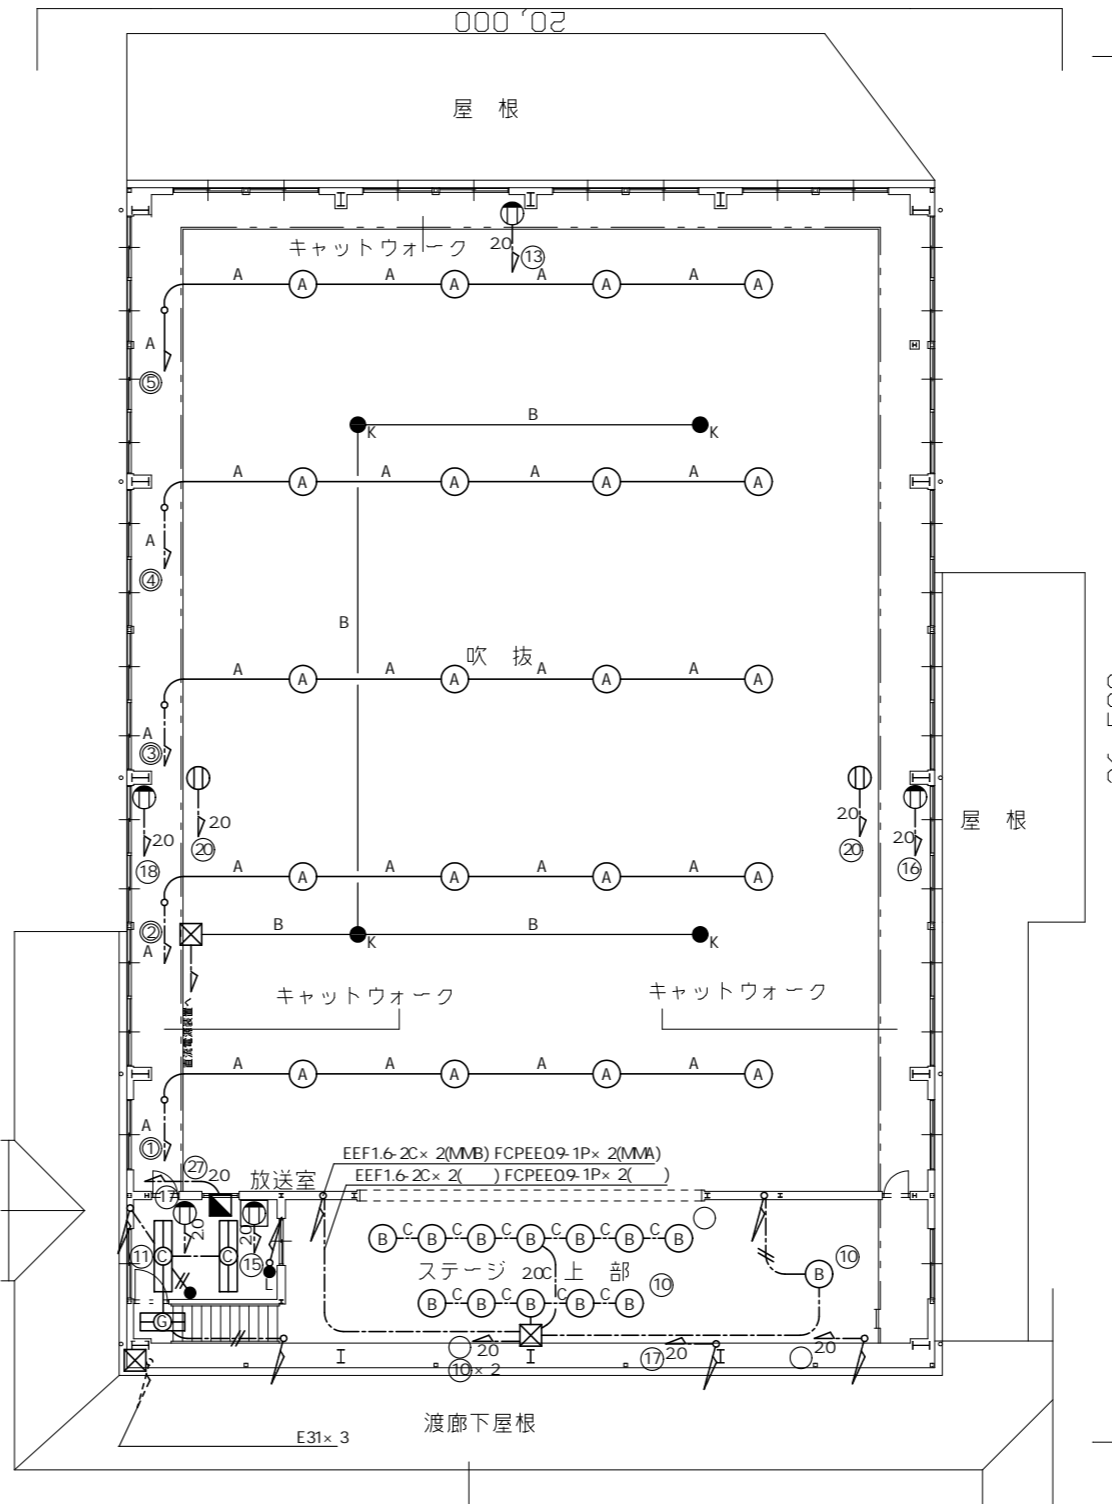


体育館2階改修平面図 1/200

- EEF1.6-3C E19
- 20 EEF20-3C E25
- // EEF1.6-2C E19
- 20 EEF1.6-3C
- 20 EEF20-3C
- // EEF1.6-2C
- A EEF20-3C E25 39 CPEEQ9-1P
- B EM-FP-C20-2C ( )
- C EEF1.6-3C FCPEEQ9-1P
- 20C EEF20-3C FCPEEQ9-1P
- (A) LED 700 (25,000lm) 60,000
- (B) LED FHT57 × 3
- (C) LED 5200lm
- (D) LED 5200lm
- (E) LED 3200lm LSS1-4-30
- (F) LED 3200lm LSS9-2-30
- (G) LEDプラケット (FL20-1定格相当) SUS 防湿型・防雨型
- (H) LED 400m
- (I) LED B
- (J) LED 100W
- (K) LED 1P15A " "
- (L) " " " "
- (M) LED 2P15A × 2 " "
- (N) LED 2P15A × 2 " "
- (O) LED 2P15A " "
- (P) " " " "
- (Q) LED 400W DC108V 7Ah(20 )
- (R) LED 450
- (S) SUS ( )


1階配線図 1:200

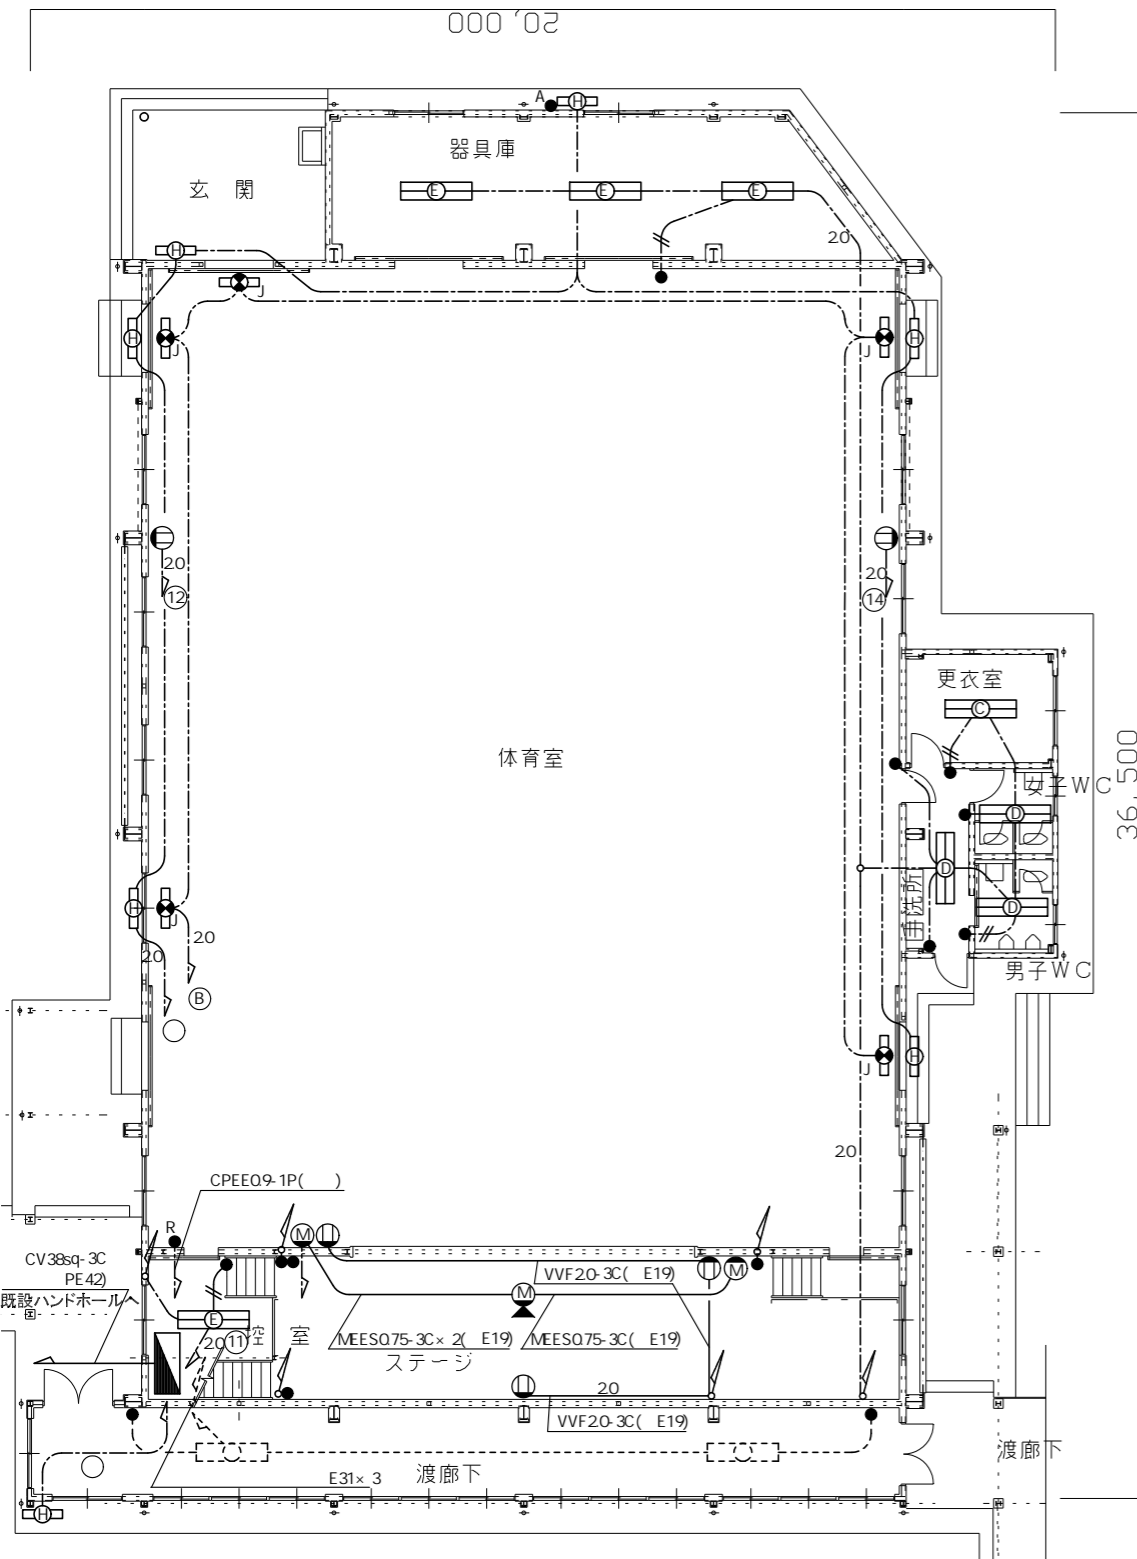

体育館1階撤去平面図 1/200

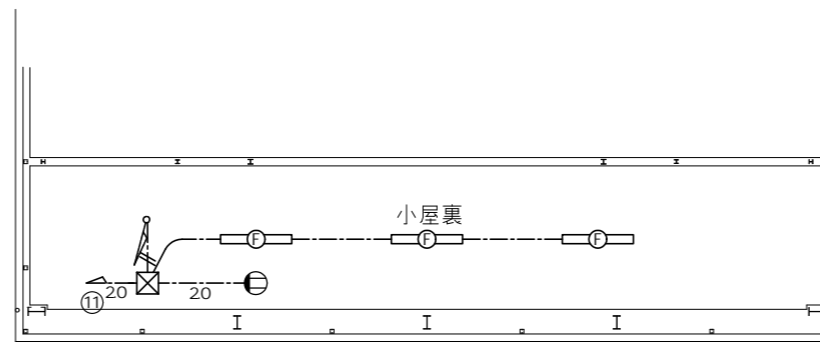

体育館小屋裏撤去平面図 1/200

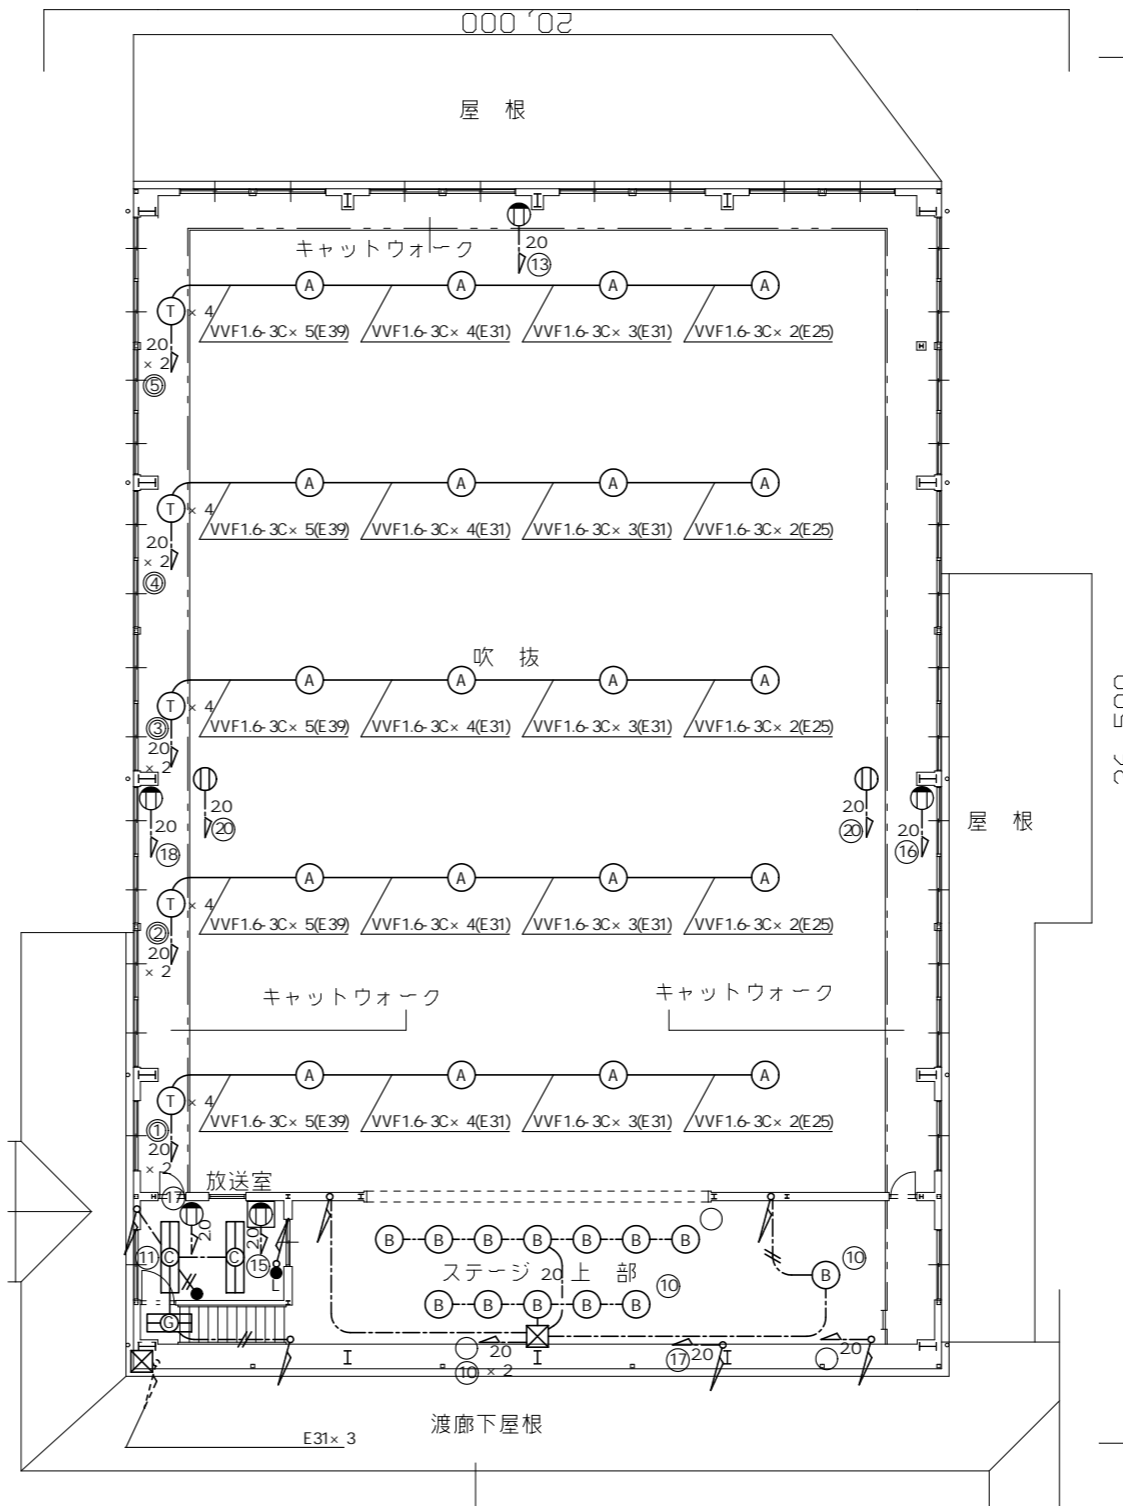

体育館2階撤去平面図 1/200

-----	VVF1.6-3C	
-----20	VVF20-3C	
-----//	VVF1.6-2C	
(A)	400	
(B)	250	IRS2-J250
(C)	FL40W×2	FSS4-402
(D)	FL40W×2	FSS4MP-402
(E)	FL40W×2	FSS4-402
(F)	FL40W×1	FSS1-401
(G)	FL20W×2	FSS4-202
(H)	FL20W×1	FBC2RP-201
(J)		B
●		1P15A
" "	"L"	" "
●R		
●A		
⊕		2P15A×2"
⊖		2P15A×2
⊙		2P15A
⊚		" "
" "	" "	" "
(T)×4		×4 BOX
⊗		
⊠		W600× H1950× D250
---		
( )		SUS